


# Dual System (In Floor Radiant / Forced Air)

**NOTE**  
If heating loops are above manifolds, additional controls (e.g. zone valve or flow check) may be needed to prevent ghost flow (see Radiant Heat with Flow-Check Valve illustration).

For illustration purposes only:  
 • Water heater styles may vary.  
 • Size of incoming line may vary (depending on application).  
 • Location of thermostat may vary.

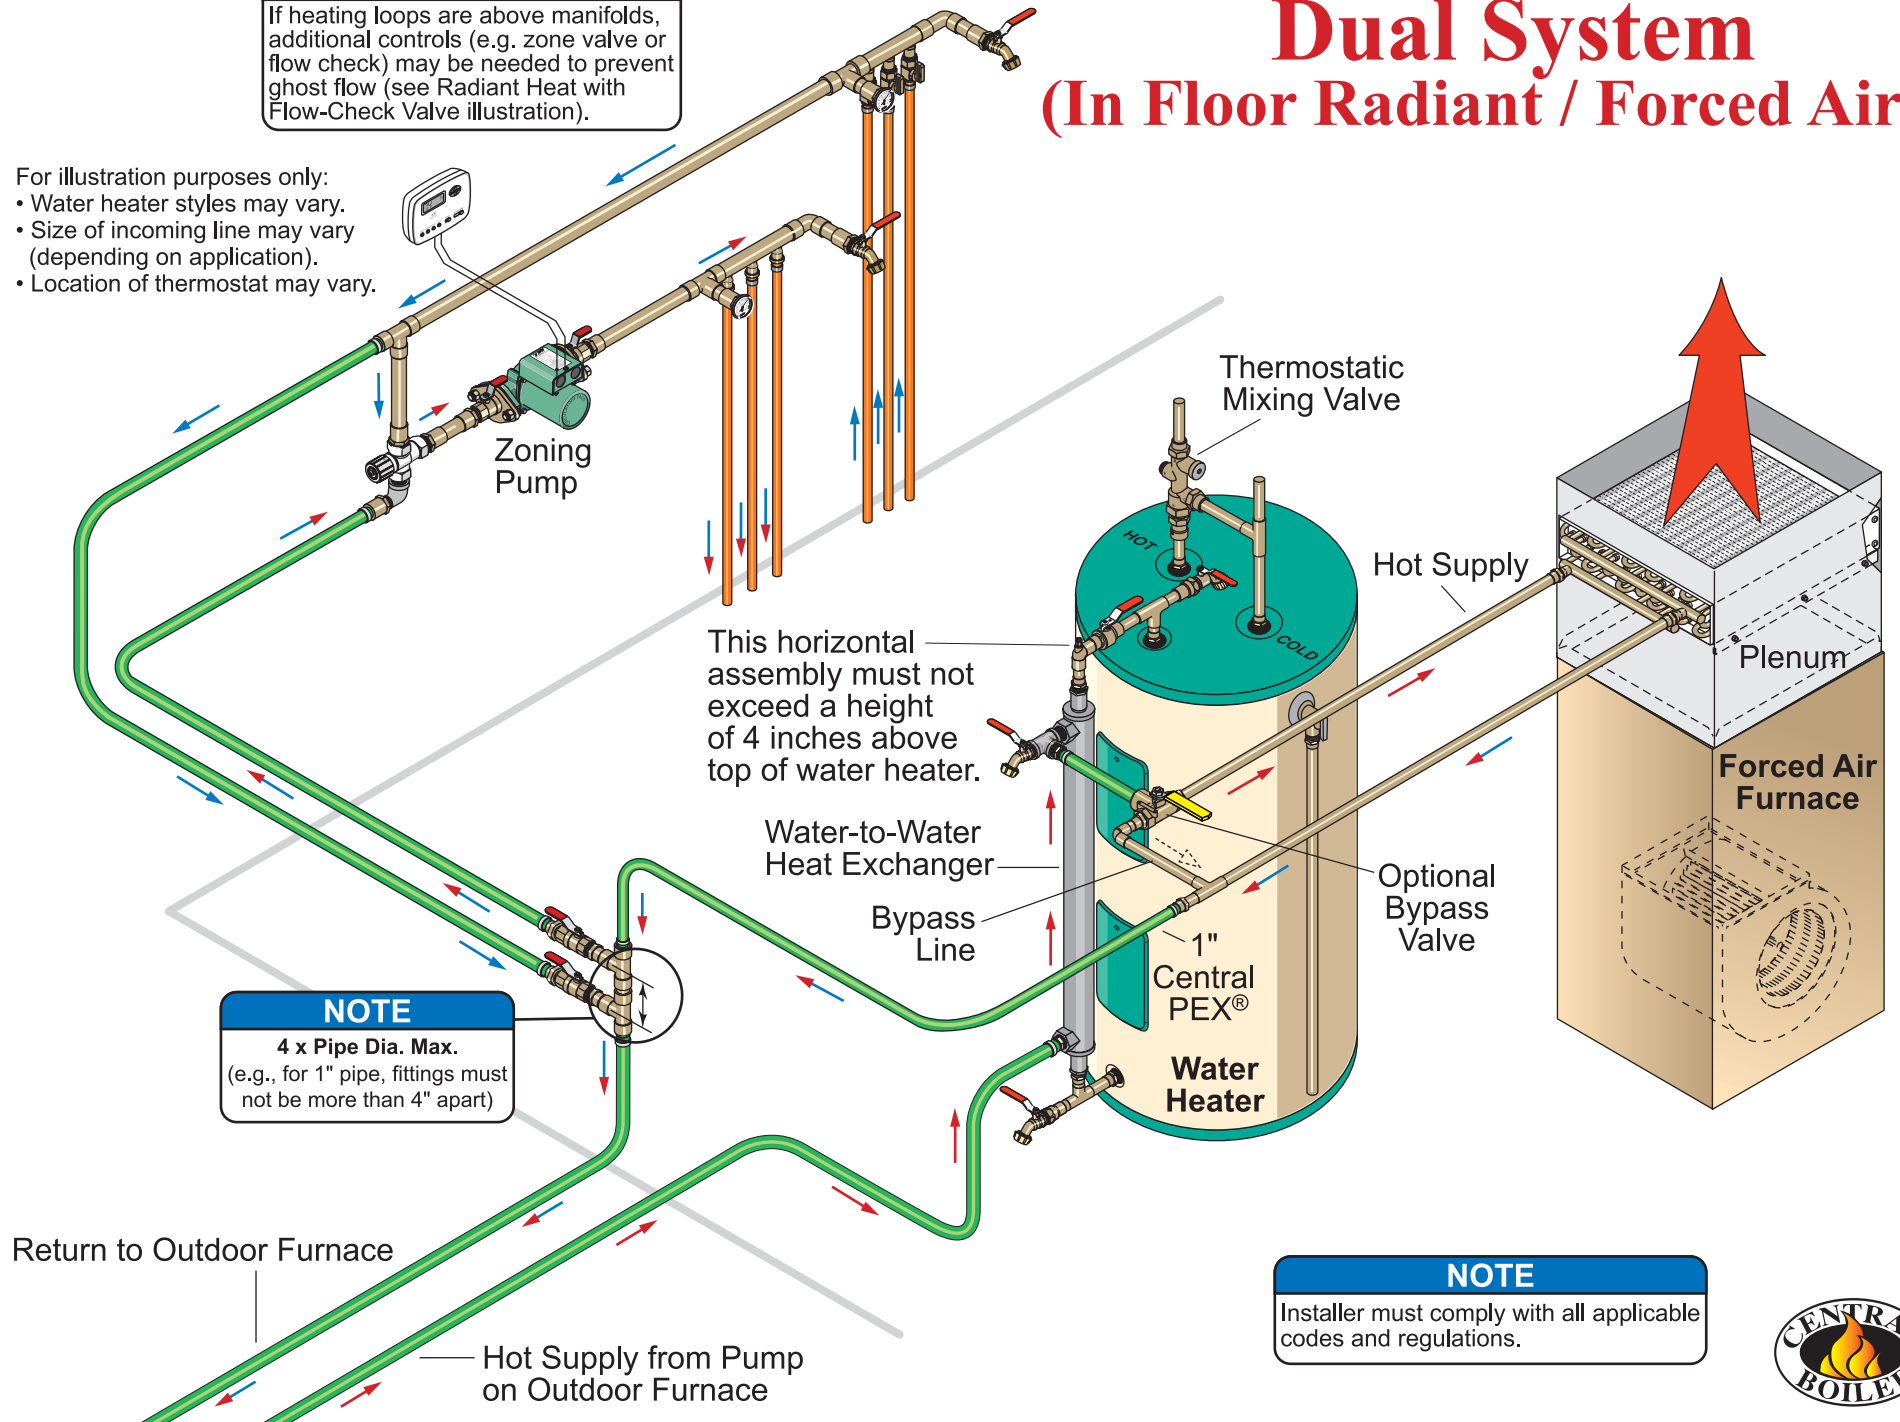

**NOTE**  
4 x Pipe Dia. Max.  
(e.g., for 1" pipe, fittings must not be more than 4" apart)

**NOTE**  
Installer must comply with all applicable codes and regulations.

