


# Existing Boiler (Direct Plumbed) Depressurized

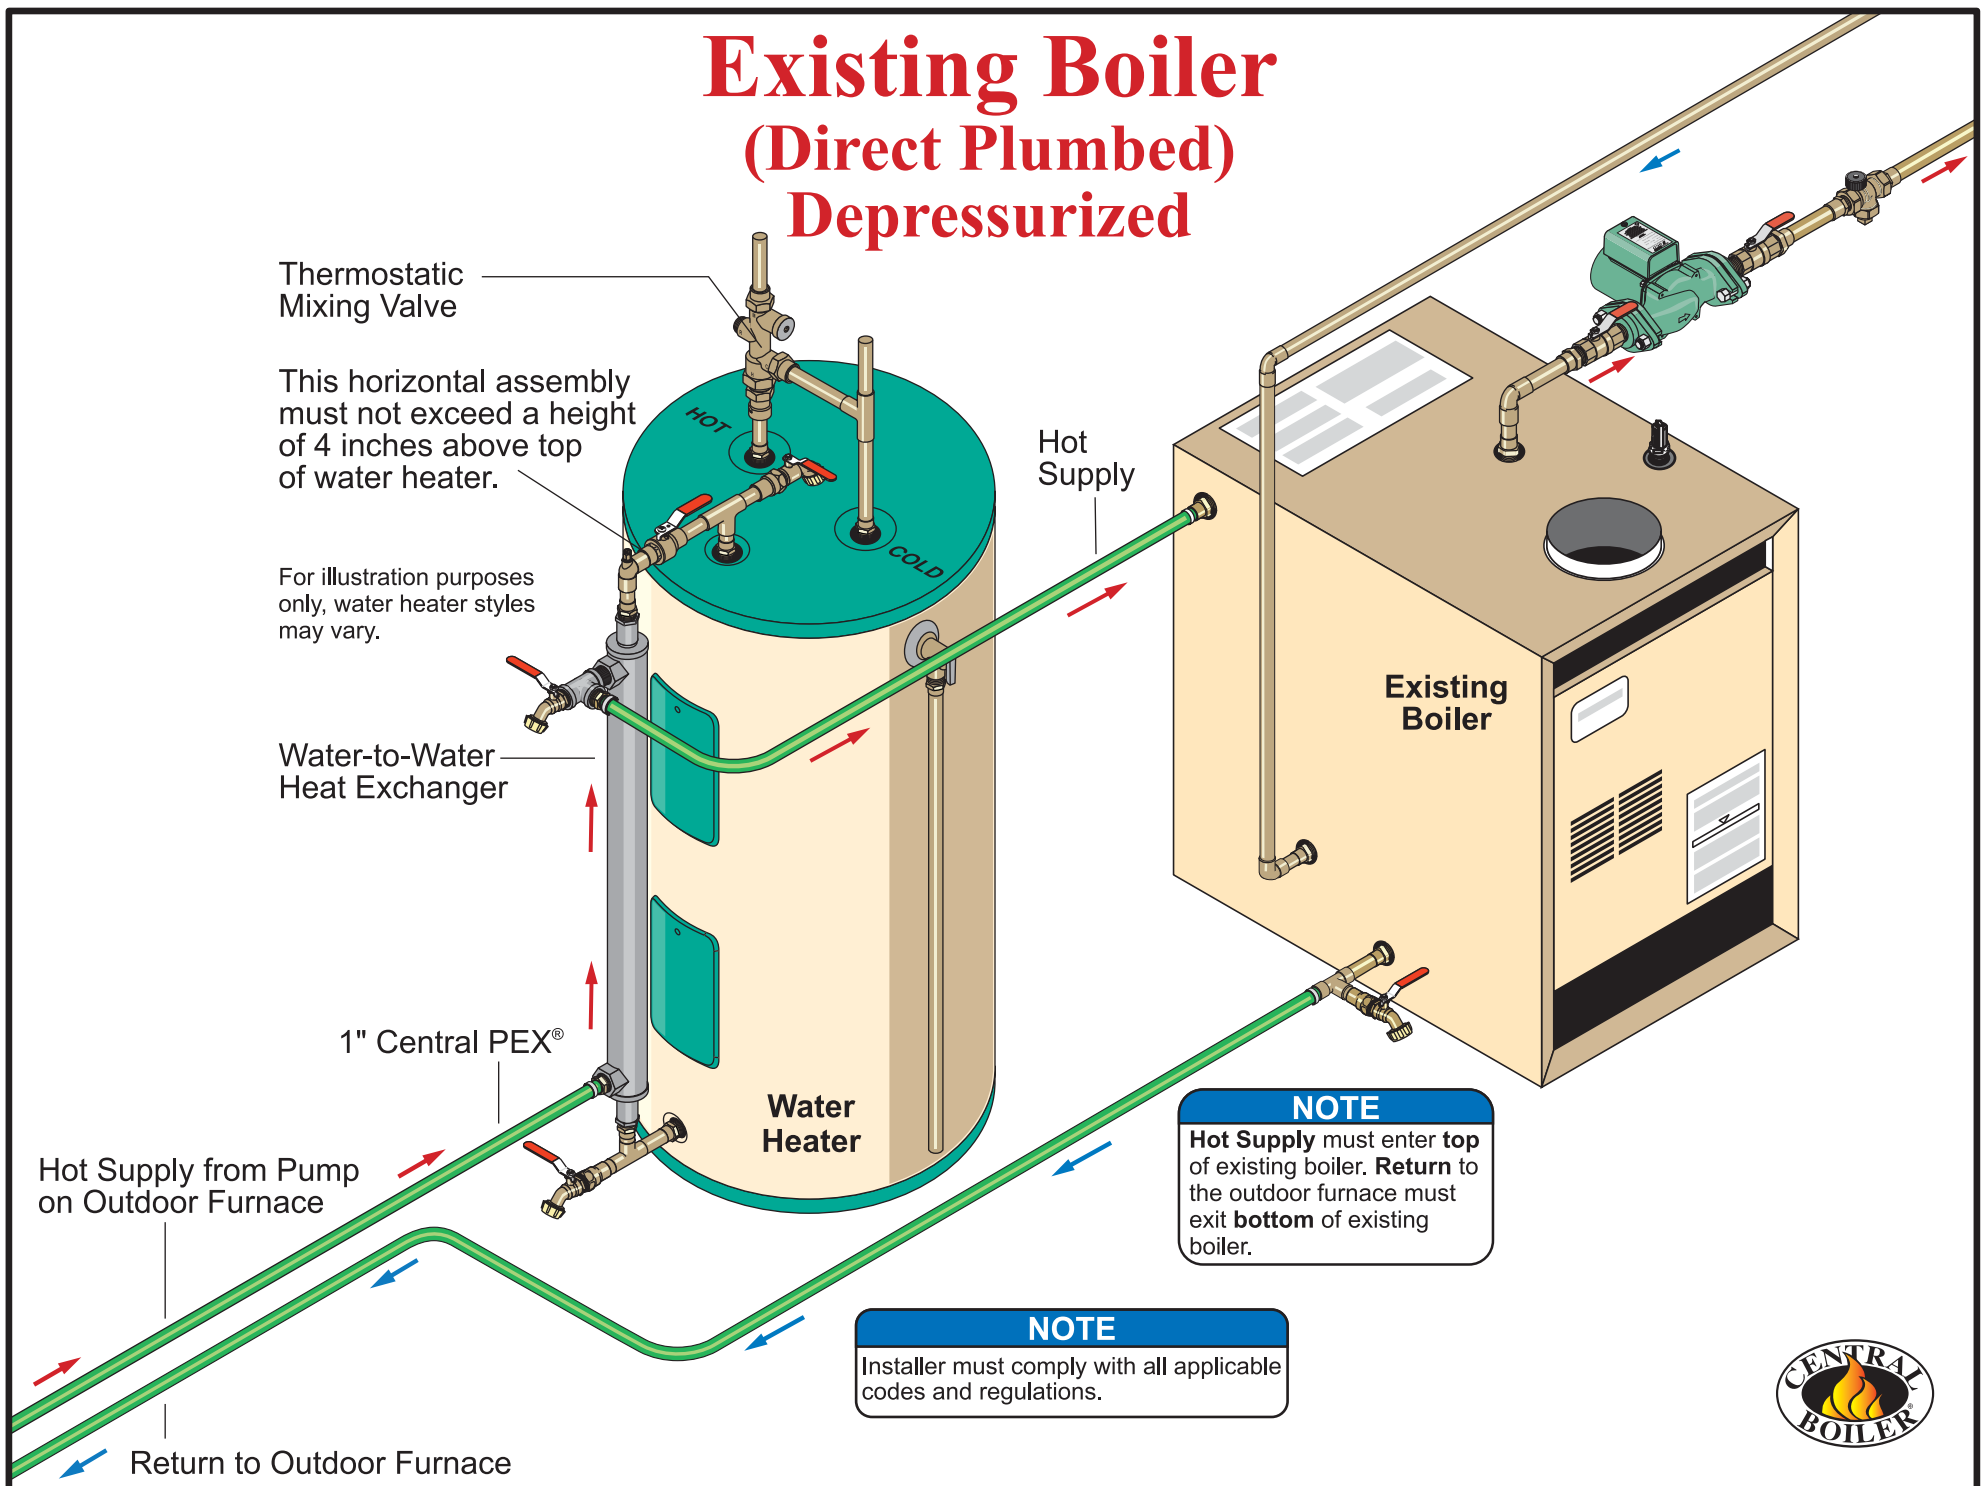

Thermostatic  
Mixing Valve

This horizontal assembly  
must not exceed a height  
of 4 inches above top  
of water heater.

For illustration purposes  
only, water heater styles  
may vary.

Water-to-Water  
Heat Exchanger

1" Central PEX®

Hot Supply from Pump  
on Outdoor Furnace

Return to Outdoor Furnace

Hot  
Supply

Existing  
Boiler

**NOTE**  
Hot Supply must enter top  
of existing boiler. Return to  
the outdoor furnace must  
exit **bottom** of existing  
boiler.

**NOTE**  
Installer must comply with all applicable  
codes and regulations.

